



## Bryan Municipal Light & Water Utilities

841 East Edgerton Street


P.O. Box 30

Bryan, Ohio 43506

PH: 419-636-4232 Ext. 227

FAX: 419-636-8026

ENTERED

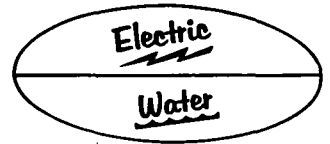


May 27, 1994

Luann Unger;

Enclosed is a map of the city of Bryan and the water distribution lines. The well locations are circled on the map. Well logs and a paper with our 1993 statistical data are also included. We have 3317 water meters in our system. The population of our city is approximately 9000 people. I put a couple extra charts in this package just for your information. The green book, Ground-Water Resources, can be used but I would very much like to have it back. If I can be of any further assistance feel free to call. If you have any information that you can share with us that would be appreciated.

Sincerely

Steve Casebere  
Bryan Water Superintendent

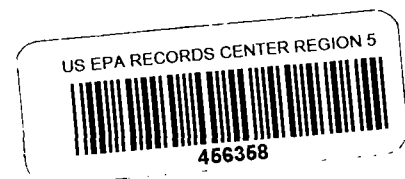

## Water Department 1993 Statistical Data

Well No. 1—Perry Street	122 feet deep, 12" casing Capacity 850 g.p.m. Gallons pumped in 1993	139,332,629
Well No. 2—Perry Street	120 feet deep, 10" casing Capacity 580 g.p.m. Gallons pumped in 1993	79,897,320
Well No. 3—Edgerton Street	137 feet deep, 10" casing Capacity 628 g.p.m. Gallons pumped in 1993	43,966,708
Well No. 4—Edgerton Street	147 feet deep, 14" casing Capacity 1,267 g.p.m. Gallons pumped in 1993	158,359,443
Well No. 5—Edgerton Street	137 feet deep, 16" casing Capacity 1,190 g.p.m. Gallons pumped in 1993	147,917,018
Well No. 6—Trevitt Street	125 feet deep, 10" casing Capacity 595 g.p.m. Gallons pumped in 1993	41,202,088
Well No. 7—Garden Street	130 feet deep, 12" casing Capacity 467 g.p.m. Gallons pumped in 1993	<u>41,202,088</u>
<b>Total Well Output in Gallons</b>		<b>652,554,160</b>


Customer Class	No. of Meters	Gallons Used
Residential	2,690	168,710,652
Commercial	502	65,224,852
Industrial	93	310,874,036
City of Bryan	31	8,511,492
Filter Backwash Water	<u>1</u>	<u>3,274,100</u>
Total	3,317	556,595,132
Line Flushing, Losses and Fire Fighting—14.71%		<u>95,959,028</u>
<b>Total Metered and Line Losses in Gallons</b>		<b>652,554,160</b>

Bacteria Samples Tested at WTP Laboratory		Iron Samples Tested at WTP Laboratory	
Raw Water	30	Raw Water	16
Finished Water	132	Finished Water and Red Sand Filter Effluent	72
Other Customers	<u>809</u>	Other Customers	<u>100</u>
Total Bacteria Tests	971	Total Iron Tests	188



# Total Water Production

## Bryan Water Treatment Plant

### 1956 - 1993

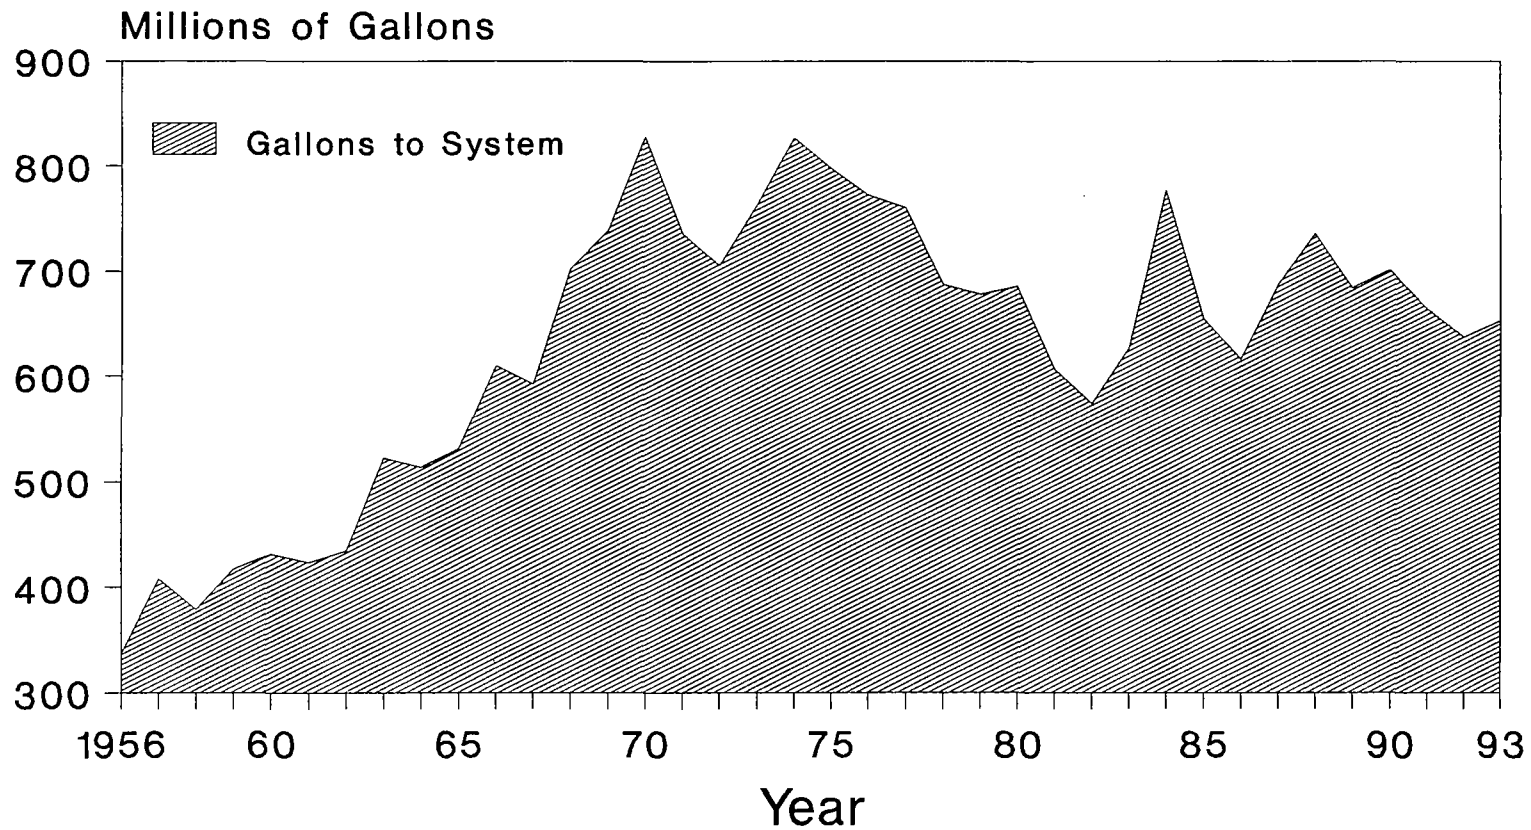

# Breakdown of Water Usage by Customer Class Bryan Municipal Light & Water

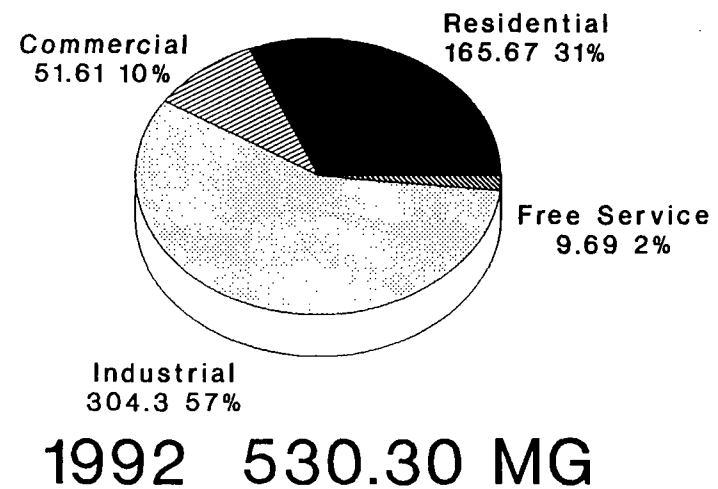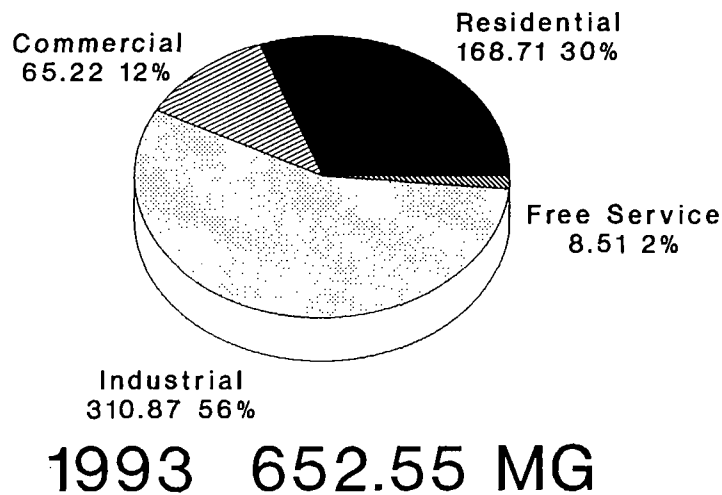

Numbers are in Millions of Gallons